




NOTES:

1. E/ONE ALARM PANEL TO BE MOUNTED ON DWELLING. LOCATION TO BE DETERMINED BY HOMEOWNER.
2. DEPTH OF INFLUENT LINE FROM DWELLING TO BE DETERMINED BY HOMEOWNER.

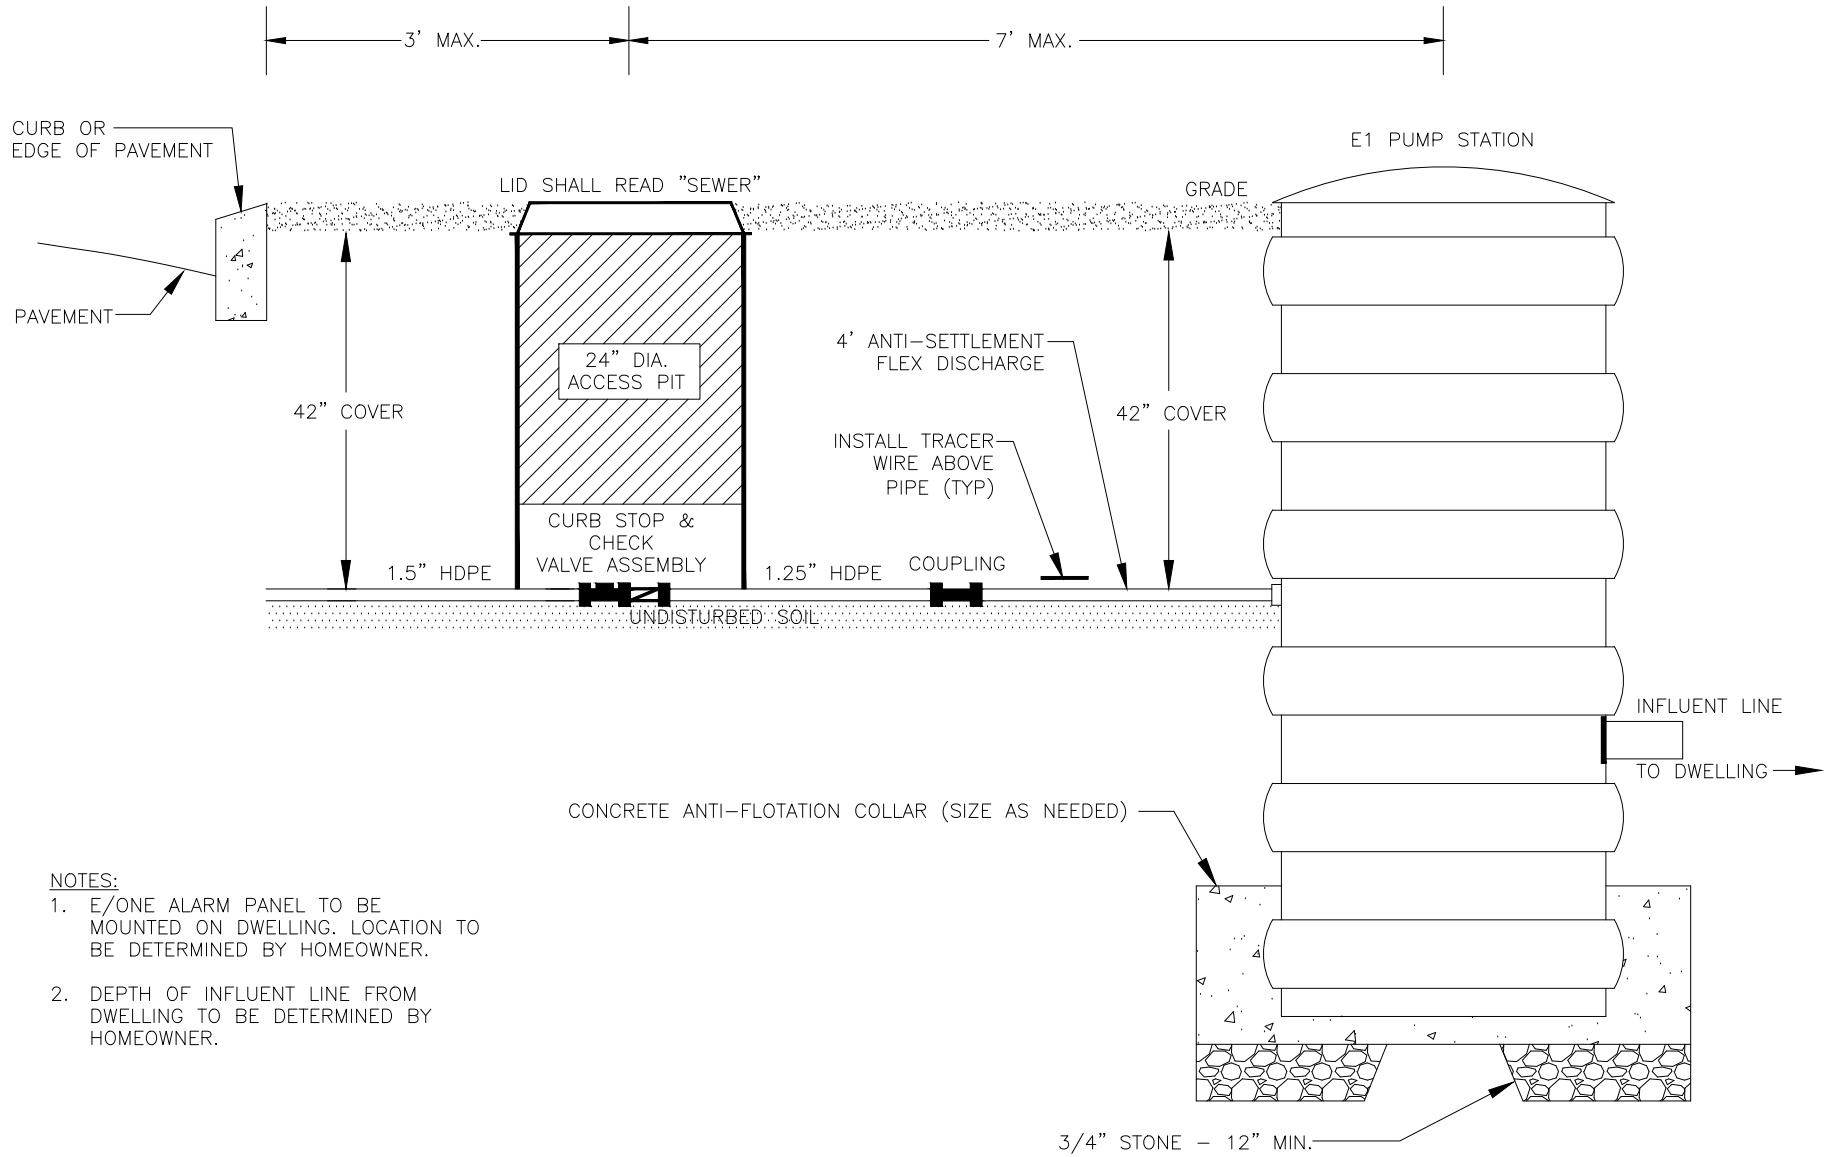

LANDIS SEWERAGE
AUTHORITY

1776 S MILL RD
VINELAND, NJ 08360

E1 UNIT PUMP STATION
DETAIL (NTS)

THIS DETAIL IS SUBJECT TO REVISION,
VERIFY WITH LANDIS SEWERAGE
AUTHORITY PRIOR TO IMPLEMENTATION

LSA DETAIL NO.

SS-E1-1

REVISED: 9/2/2025